

Our Ref. No. VB/me/R4547/18

Date: 10th October 2018

*The CEO
Regulator for Energy and Water Services
Millenia, 2nd Floor
Aldo Moro Road
Marsa*

Attn. Ing. Marjohn Abela

Your Ref.: MRA/P/203/12

Commissioning Report

Subject: Fuel Storage at Gasparell Bailing Plant – Hal Far

Dear Sir,

This is to certify that we have commissioned the fuel storage installed at the premises in caption, which comprise of an 875 litre capacity reservoir which forms part of an equipment which recovers fuel, engine oil and hydraulic oil from vehicles designated for scrapping.

Since the fuel recovery reservoir forms part of a proprietary equipment, replacing the fuel tank by a smaller reservoir with less than 300 litres was not possible, due to equipment classification and certification.

It has thus been decided to limit the extent of fill into the reservoir to 290 litres, by installing an overfill prevention system, utilising specifically designed equipment and control devices as per documents 'A' and 'B' hereby attached.

Photos 1, 2, 3 and 4 hereby attached provide a clear indication of the equipment and the fuel recovery storage tanks. The fuel storage tank has been equipped with an overhead transfer pump. The tank is designed for internal installation and is equipped with a proprietary air vent as shown on photo 4.


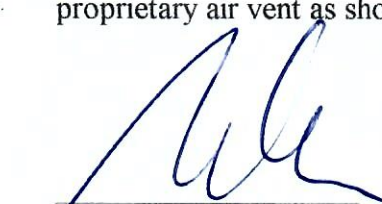

Ing. Victor Bonello
Warrant No. 381





Photo 1

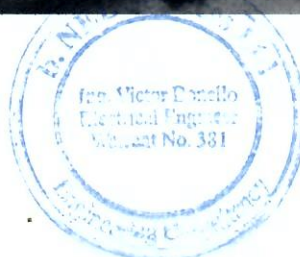

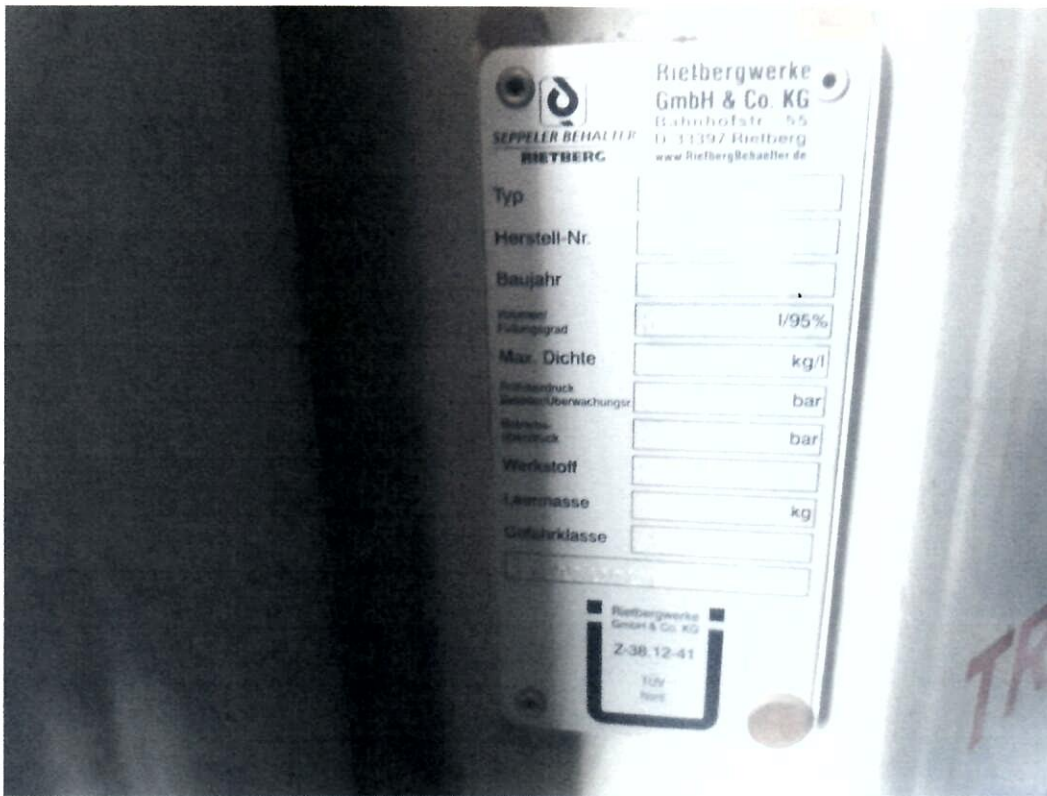


Photo 2



Photo 3

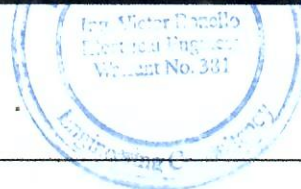


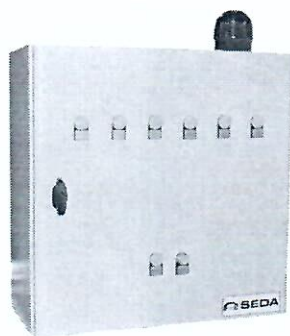


Photo 4





World leader in vehicle
de-pollution technology



SEDA Overfill Protection

N-526116

Consisting of:

- Level sensor
- Transmitter
- Alarm module (visual and audible)
- Switching output for solenoid valves
- Pre-assembled

Power supply and cables to the tanks **are required!**



Your benefits:

- Complete overfill protection for 1 to 8 tanks
- Acoustic and visual alarm signal
- Automatically stops pumps when reaching filling level (fuel: switch off air pressure for TankDrillingMachine)
- Meets guidelines according to WHG
- Executed according to ATEX



Leading Company
of Austria


Safety device for tanks

The ideal solution for overfill prevention of your tanks. With its easy installation and the option of connecting acoustic or optic signals directly to the transducer, the overfill prevention has proven its reliability. From two tanks on, the overfill protection is installed in a control cabinet.

When dealing with liquids hazardous to water, overfill protection is an indispensable element for environmental protection.


1-point measurement:

Shutdown of the pump at approx. 90% capacity.



2-point measurement:

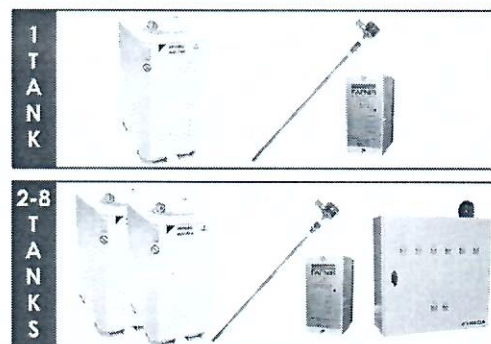Warning message at 1. measuring point and switch-off of the pump at approx. 90% filling quantity (2. measuring point).



TECHNICAL DETAILS

Weight:	appr. 15 kg
Dimensions:	60 x 72 x 28 cm
Power supply:	230 V

ORDER INFORMATION

N-526116-1/8 SEDA Overfill protection for 1-8 tanks with 1-point measurement

N-526116-1/8 SEDA Overfill protection for 1-8 tanks with 2-point measurement



SEDA-Umwelttechnik GmbH

Schwendter Str. 10 / 6345 Kössen / Tirol / Österreich
UID-Nr.: ATU56621622 / FB-Nr.: FN 231790 v / FB-Gericht: Innsbruck
Certified company according to DIN EN ISO 9001

T: +43 5375 6318-0
F: +43 5375 6318-9
E: info@seda.at
W: www.seda-international.com

LS 300

Standaufnehmer

LS 500

Messumformer



Ausgabe: 2016-09
Version: 5
Art.-Nr.: 207039



Petroleum for the Inland (Retail) Fuel Market Regulations – S.L. 545.22

NOTIFICATION / APPLICATION FOR THE GRANTING, RENEWAL OR TRANSFER OF AN AUTHORISATION TO OPERATE A SECONDARY STORAGE FACILITY OF PETROLEUM

1.0 Application Type

Please tick "✓" against the appropriate box:

<input checked="" type="checkbox"/> Notification Applicable for: <ul style="list-style-type: none">Class 1¹ Fuels in storages with a capacity greater than 60 litres but less than 300 litres.Class 2² and Class 3³ Fuels in Storages with a capacity greater than 300 litres but less than 3,000 litres.	<input type="checkbox"/> Granting Applicable for: <ul style="list-style-type: none">Class 2 and Class 3 Fuels in storages with a capacity greater than 3,000 litres.	<input type="checkbox"/> Renewal	<input type="checkbox"/> Transfer
--	---	----------------------------------	-----------------------------------

2.0 Details of the Applicant

Please insert your personal details if applying as an individual. If the application is being submitted on behalf of a Company or a Legal Organisation, the details of the Legal Representative shall be inserted instead.

Full Name of Individual or Legal Representative: GOODFREY GASPAR CUTAJAR.			Contact Address: HHF 601 Qasam Industrijali Hal Far Bir Zebbuġ.
I.D. / Passport No.: 117476(M)	Tel. No. (Fixed Line): 21651475	Tel. No. (Mobile): 99495236	
Email: gasparell.b@gmail.com			
Name of Company / Legal Organisation (if applicable): GASPARILL BAILING CO. LTD.			
VAT No. (if applicable): 1224 4830			Company (or equivalent) Reg. No. (if applicable):



¹ Class 1 means fuels having a flash point below 21°C such as EN228 (Petrol), Ethanol and Bio-Ethanol used for energy purposes

² Class 2 means fuels having a flash point above 21°C but below 55°C such as Kerosene and Jet Fuel

³ Class 3 means fuels having a flash point above 55°C such as EN590 (Diesel), BioDiesel



3.0 Details of current Authorised Person (transferor)

Section to be filled-in in the case of a TRANSFER application ONLY. In the case the current authorised provider is a Company or a Legal Organisation the details of the Legal Representative shall be filled in. Leave blank if n/a.

REWS Authorisation No.:		Contact Address:	
Full Name of Individual or Legal Representative:			
I.D. / Passport No.:	Tel. No. (Fixed Line):	Tel. No. (Mobile):	
Name of Company / Legal Organisation (if applicable):			
Email:		Company (or equivalent) Reg. No. (if applicable):	
Declaration of current authorised person: I, the undersigned authorised person declare that I give my unconditional consent to the transfer of the above-mentioned REWS authorisation to the third party as indicated in section 2.0 above. I understand that this eventual transfer (if any) does not exonerate me from fulfilling any obligations arising from any authorisation or any applicable law including the payment of any amount due to the Regulator.			
Signature of current authorised person			Date

4.0 Operational Details

Please indicate details on the Tanks of the Secondary Storage Facility of Petroleum:

Address of installation site:		Category: <input type="checkbox"/> Domestic <input checked="" type="checkbox"/> Industrial <input type="checkbox"/> Commercial		
		Estimated annual Fuel throughput (Litres of Fuel per annum): 800L		
Tank No.	Holding Maximum Liquid Capacity (Litres)	Fuel Type	Tank Location	Intended Use ⁴
1	290	PETROL	<input checked="" type="checkbox"/> Above Ground <input type="checkbox"/> Buried / Mounded	Low concentration mix with diesel for
1	1	1	<input type="checkbox"/> Above Ground <input type="checkbox"/> Buried / Mounded	Bombus train in
			<input type="checkbox"/> Above Ground <input type="checkbox"/> Buried / Mounded	Bailer Diesel Engine
			<input type="checkbox"/> Above Ground <input type="checkbox"/> Buried / Mounded	



⁴ List purpose of use of the mentioned fuel (e.g. own vehicle propulsion, stand-by electricity generation, water heating, central heating, furnace heating, cooking etc.)



5.0 Documentation

Please submit the following documentation:

In the case of an **EXISTING** installation⁵:

- 5.1. ☐ An Inspection Report including a risk and safety assessment report of the Installation by a Competent Person together with photographs of the Installation.
- 5.2. ☐ A copy of the Insurance Schedule and its respective Insurance Policy details indicating the liability coverage to third parties against bodily injury and property damage caused by the storage of Fuel and the associated operations of the Secondary Storage of Petroleum.
- 5.3. ☐ A copy of the ERA Environmental Permit / Integrated Pollution and Prevention Control (IPPC) Permit covering the Installation.
- 5.4. ☐ A copy of the PA Compliance Certificate covering the installation.

In the case of a Notification⁶ of a **NEW** Installation:

Upon Completion of the Secondary Storage Facility of Petroleum

- 5.5. ☒ A Commissioning Report together with a *Secondary Storage Facility (Non-LPG) Commissioning Report Declaration*⁷ of the Installation both compiled by a Competent Person.
- 5.6. ☐ A copy of the Insurance Schedule and its respective Insurance Policy details indicating the liability coverage to third parties against bodily injury and property damage caused by the storage of Fuel and the associated operations of the Secondary Storage of Petroleum.
- 5.7. ☐ A copy of the ERA Environmental Permit / Integrated Pollution and Prevention Control (IPPC) Permit covering the Installation.
- 5.8. ☐ A copy of the PA Compliance Certificate covering the installation.

In the case of a Granting⁶ of a **NEW** Authorisation :

At the Design Stage of the proposed Secondary Storage Facility of Petroleum:

- 5.9. ☐ Technical Proposal compiled by the Competent Person indicating the proposed design details of the Installation

Upon Completion of the proposed Secondary Storage Facility of Petroleum:

- 5.10. ☐ A Commissioning Report together with a *Secondary Storage Facility (Non-LPG) Commissioning Report Declaration*⁷ of the Installation both compiled by the Competent Person.
- 5.11. ☐ A copy of the Insurance Schedule and its respective Insurance Policy details indicating the liability coverage to third parties against bodily injury and property damage caused by the storage of Fuel and the associated operations of the Secondary Storage of Petroleum.
- 5.12. ☐ A copy of the ERA Environmental Permit / Integrated Pollution and Prevention Control (IPPC) Permit covering the Installation.
- 5.13. ☐ A copy of the PA Compliance Certificate covering the installation.



⁵ An existing Installation is one that has been in operation **before** January 2010.

⁶ Please refer to Section 1.0 'Application Type'.

⁷ Please refer to REWS website (www.rews.org.mt) for document entitled '*Secondary Storage Facility (Non-LPG) Commissioning Report Declaration*'.

6.0 Declaration of the Applicant

I, the undersigned applicant, hereby confirm that the information contained in this application (including any documents submitted) is true and correct, and that it represents accurately the information being requested.

I undertake to inform the Regulator for Energy and Water Services of any changes in the information that may occur from time to time and contained in this application, and documentation required to be submitted with this application. I also authorise the Regulator for Energy and Water Services to carry out the necessary investigations in order to verify this information. I also undertake to give any other information that may, from time to time, be requested by the Regulator.

I understand that with the granting of the authorisation being applied for, I shall automatically be subjected to the conditions of the authorisation issued by the Regulator. I also understand that the conditions listed in the authorisation may be modified as prescribed by law. I undertake to abide by any approved standards, Codes of Practice, authorisation conditions or requirements of the Regulator with regard to the activity being authorised.

I understand that the granting of the authorisation being applied for will not exonerate me from obtaining and, or maintaining any other authorisation, licence or permit as required under any law or legal obligation. I understand that the Regulator may suspend or revoke my authorisation should it transpire that the information submitted in this application is not correct, and, or if I fail to abide with any approved standards, Codes of Practice, conditions or requirements of the Regulator.

Please tick "✓" against the appropriate box:

- ☐ I declare that I have NOT been found guilty and, or have NOT been convicted of a criminal offence and, or have NOT been subject to any form of enforcement action by any official authority in the past 5 years and, or there are NO pending charges against me.
- ☐ I declare that I have been found guilty and, or convicted of a criminal offence and, or have been subject to an enforcement action by an official authority in the past 5 years and, or there are pending charges against me.

Please tick "✓" against the appropriate box:

- ☐ I declare that I have NEVER had a licence or permit and, or other form of registration of any kind refused, suspended, revoked or cancelled by any regulatory authority.
- ☐ I declare that I have had a licence or permit and, or other form of registration of any kind refused, suspended, revoked or cancelled by any regulatory authority.

_____/_____/_____
Signature of applicant (in agreement of all of the above in its entirety) Date

7.0 Data Protection Notice

In processing your personal data, the Regulator will comply with binding legislative requirements imposed by the General Data Protection Regulation EU 2016/679 (the "GDPR") and national Maltese law requiring an adequate data protection standard.

The processing of your personal data by the Regulator shall be done in the performance of a task carried out in the public interest or in the exercise of official authority vested in the Regulator and, or in compliance with a legal obligation.

In terms of these legal bases, the Regulator sometimes shares your personal information with third parties, including Government Departments (such as the Department of Customs, the Department of Health, the Civil Protection Department), other regulatory authorities (such as the Transport Authority, the Occupational Health and Safety Authority, the Planning Authority, the Environment and Resources Authority, the Malta Competition and Consumer Affairs Authority) and other Government Agencies and entities such as the Energy and Water Agency and the National Statistics Office.

You may access the Regulator's Data Privacy Policy at: <https://www.rews.org.mt/#/en/a/51-privacy-policy>

8.0 Application Fee

The non-refundable application fee for this application is € 50 (Fifty Euros).

For office use

Received by: _____

Official stamp:

Date: ____/____/____



Petroleum for the Inland (Retail) Market Regulations – S.L. 545.22

SECONDARY STORAGE FACILITY (NON-LPG) COMMISSIONING REPORT DECLARATION¹

Disclaimer

This 'Secondary Storage Facility (Non-LPG) Commissioning Report Declaration' is intended to be used only as a basic (de minimis) document to serve as a basis for the certification by the competent person on a Secondary Storage Installation (non-LPG) as required by the Regulator for Energy and Water Services. The competent person and the responsible person/owner shall undertake to add any necessary data and information together with this document if necessary. This document does not exonerate the Competent Person from his professional obligations and duties. Neither should it be construed as, and/or should in any way be understood and/or be deemed to exonerate the Competent Person and/or the Authorised Provider from observing, or carrying out any requirement or to comply with a provision of any law or any other legal requirement. REWS makes no warranty about the content of this document and cannot be held liable under any circumstances for any direct or indirect damages resulting from its use.

1.0 General

COMMISSIONING REPORT REF ² No.:	VB/ME/R4547/18	DATE:	09/10/2018
SECONDARY STORAGE FACILITY DETAILS			
Company / Individual Name: Gasparell Bailing Co. Ltd. - Mr. Godfrey Cutajar	Company Reg. No / Individual ID Card: 117476(M)	Address of Secondary Storage Facility: Hhf 601, Qasam Industrijali, Hal Far Birzebbugia Bbg3000gas	

2.0 Competent Person details:

Full Name: VICTOR BONELLO	ID Card / Passport No.: 526364(m)	REWS Competent person No.: 381
Land Line Tel. No.: 21338490	Mobile No.: 99490064	E-mail Address: vbon@beenel.com

3.0 Storage Tank Details

Storage Tank Number	Petroleum Type	CN Code	Holding Max. Capacity (Litres)
1	Petrol	EN228	290



¹ This 'Secondary Storage Facility (Non-LPG) Commissioning Report Declaration' is to be filled in electronically, printed and signed by the Competent Person and subsequently presented to the Regulator for Energy and Water Services by the applicant together with a Commissioning Report of the facility compiled by the Competent Person.

² Please insert the corresponding Reference Number of the Commissioning Report compiled by the Competent Person of the Secondary Storage Facility.



4.0 Commissioning Tests / Examinations Carried out by the Competent Person

TEST	REFERENCE ³
<input checked="" type="checkbox"/> Visual Inspection	Factory Assembled - Part of Equipment
<input type="checkbox"/>	
<input type="checkbox"/>	
<input type="checkbox"/>	

5.0 Attachments⁴

ITEM:	REFERENCE
<input checked="" type="checkbox"/> Site Plan (Scale 1:2500)	GBP/SP/01
<input type="checkbox"/> Training Records	NIL
<input checked="" type="checkbox"/> Drawings	Photos 1 to 4
<input type="checkbox"/>	
<input type="checkbox"/>	
<input type="checkbox"/>	
<input type="checkbox"/>	

6.0 Certification by Competent Person

I, the undersigned Competent Person whose full details are given in Section 2.0, hereby declare that I have carried out the commissioning of the Secondary Storage Facility described in Section 1.0 with the necessary diligence and care on the 09 / 10 / 18 (hereafter 'commissioning date') as indicated by the Commissioning Report referenced in Section 1.0 accompanying this 'Secondary Storage Facility (Non-LPG) Commissioning Report Declaration' and have found it to be fully in conformity with the requirements laid down in the latest issue of the 'Technical Book 3: Domestic and Commercial Requirements for Oil Storage & Supply Equipment' and any other relevant bye-laws, regulations and legislation in force. Thereby, I certify this Secondary Storage Facility as being ready to start its intended operational activity. I also declare the this Secondary Storage Facility shall be due for the next inspection by a competent person on the 08 / 10 / 19 (insert next inspection date⁵)



Signature⁶ of Competent Person & Date



Official Rubber Stamp

7.0 Data Protection Notice

In processing your personal data, the Regulator will comply with binding legislative requirements imposed by the General Data Protection Regulation EU 2016/679 (the "GDPR") and national Maltese law requiring an adequate data protection standard.

The processing of your personal data by the Regulator shall be done in the performance of a task carried out in the public interest or in the exercise of official authority vested in the Regulator and, or in compliance with a legal obligation.

In terms of these legal bases, the Regulator sometimes shares your personal information with third parties, including Government Departments (such as the Department of Customs, the Department of Health, the Civil Protection Department), other regulatory authorities (such as the Transport Authority, the Occupational Health and Safety Authority, the Planning Authority, the Environment and Resources Authority, the Malta Competition and Consumer Affairs Authority) and other Government Agencies and entities such as the Energy and Water Agency and the National Statistics Office.

You may access the Regulator's Data Privacy Policy at: <https://www.rews.org.mt/#/en/a/51-privacy-policy>

³ Please insert reference corresponding to details on tests carried out as indicated on the Commissioning Report accompanying this declaration.

⁴ Please include any drawings / data sheets / supplier technical sheets as applicable

⁵ The next inspection date following the successful commissioning of a Secondary Storage Facility shall not be later than twelve months from the commissioning date. The interval of successive inspections carried out thereafter shall not exceed a period of twenty four months.

⁶ To be signed in wet ink.